ELECTRICAL NOTATIONS

1. Provide factory installed breaker ampacity per one line diagram.
2. Provide factory installed 200A rated meter.
3. Confirm AIC with SMUD.
4. Shunt trip breaker.
5. Confirm wire and conduit size with SMUD before install.

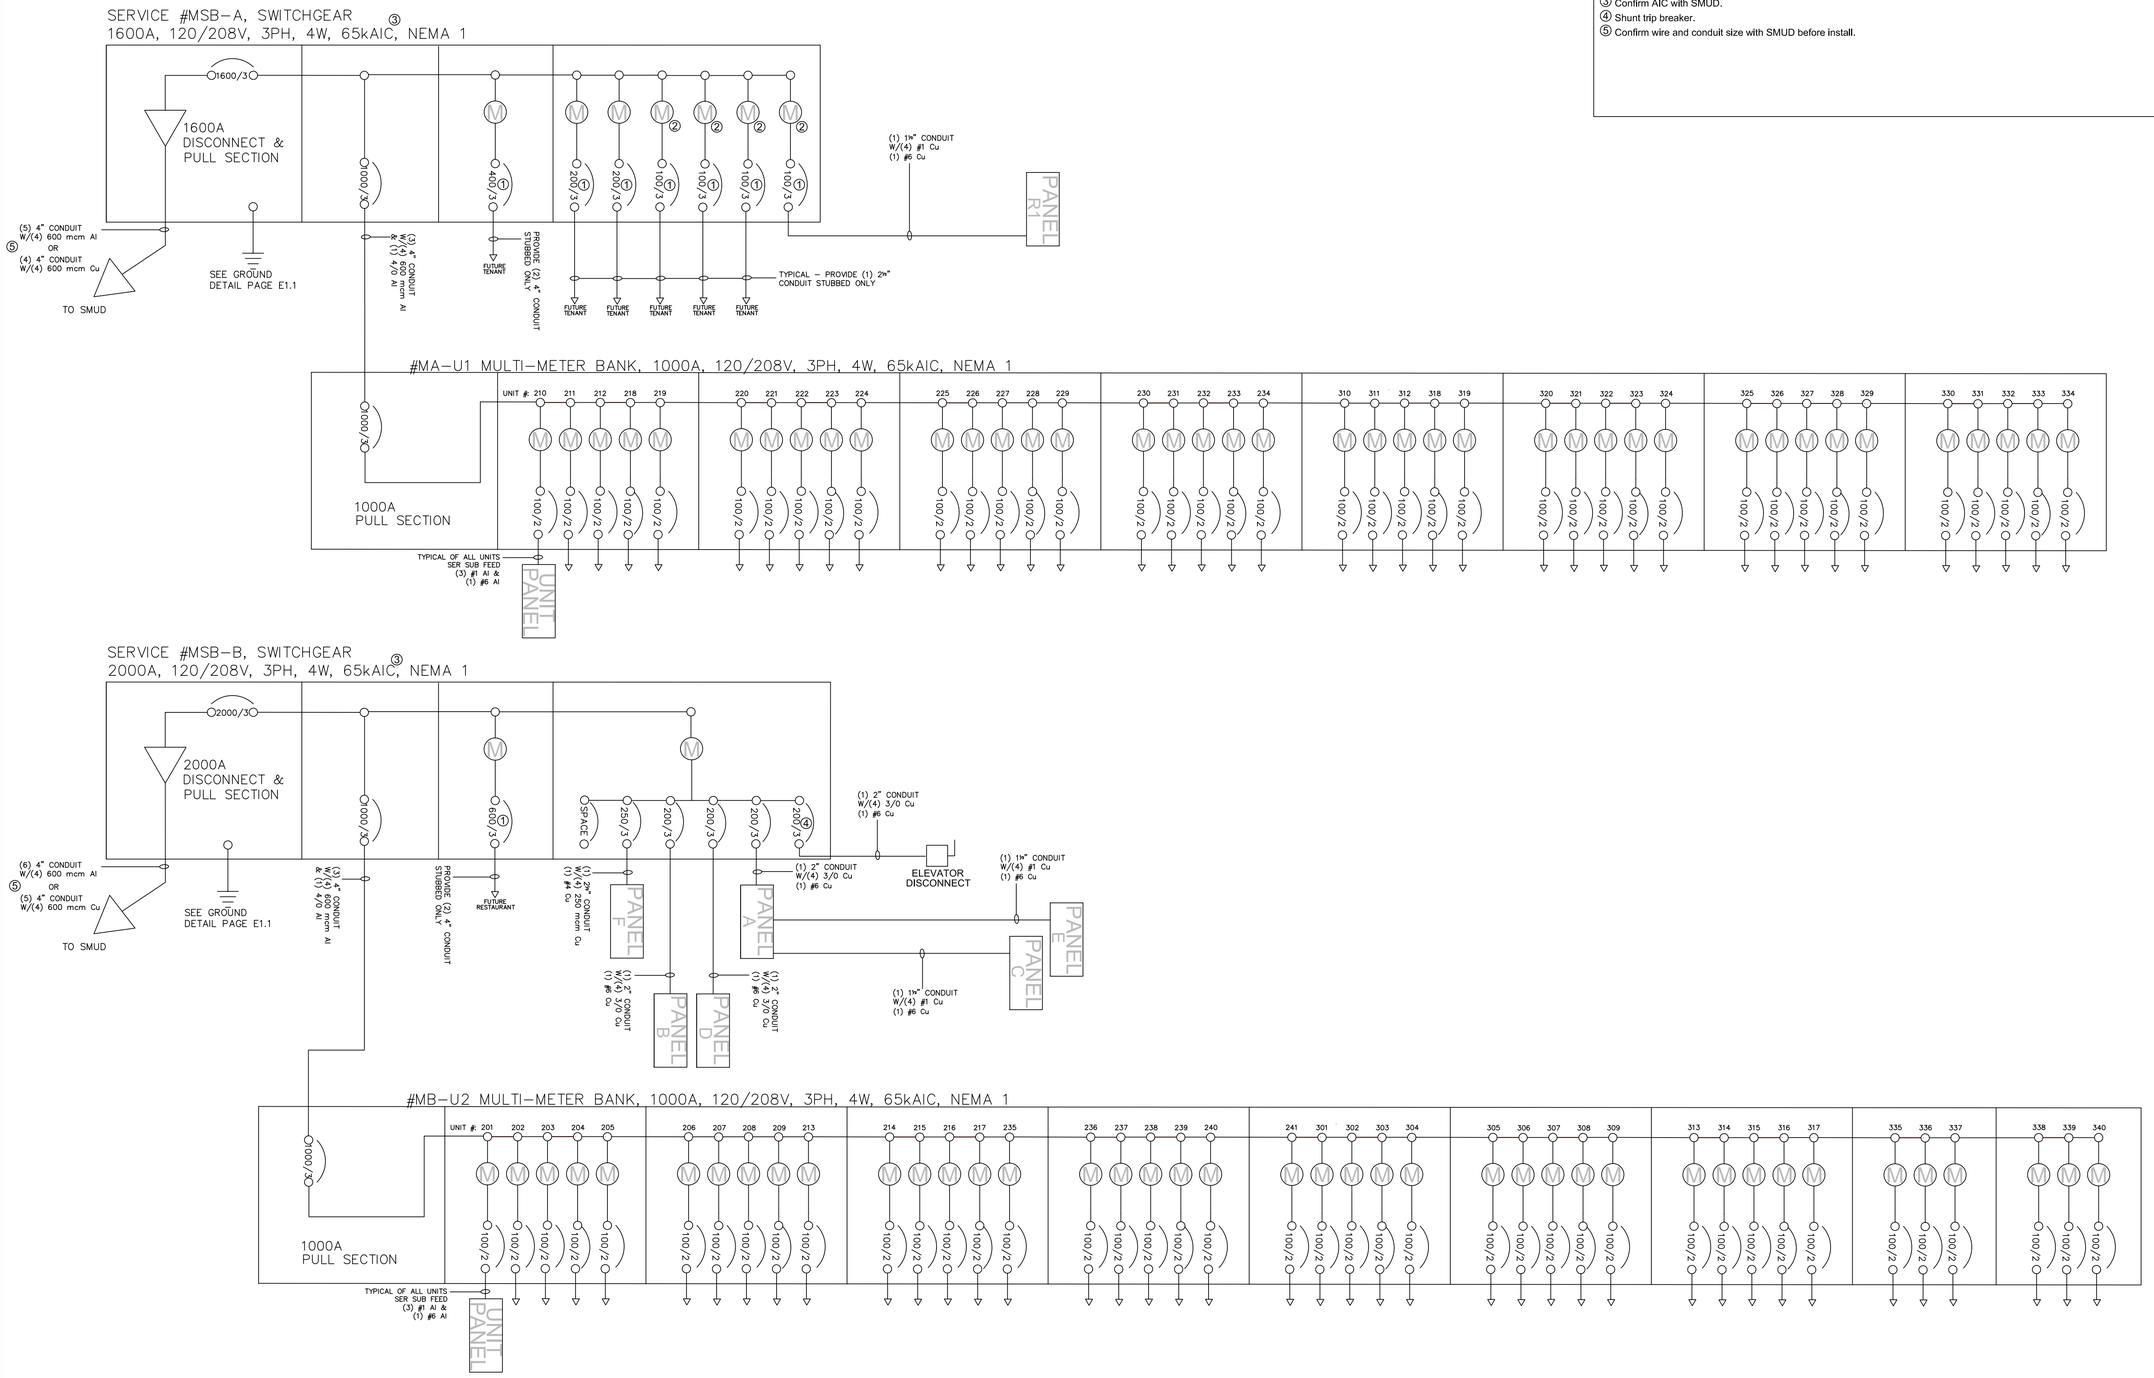

REVISIONS

Designed & Installed By:

CITIZEN ELECTRIC

DATE: 12/31/08

SIGNED:

1050 Partee Lane, Ste 100
Ceres, CA 95307
209-531-1122
209-531-1199 fax
CSL # 850186

DOWNTOWN GALT PLACE MIXED USE

ELECTRICAL ONE LINE DIAGRAMS

422 D STREET
GALT, CA 95632

DATE : 12/12/08

JOB # : 0835601PS

DRAWN : P. SPRADLING

SHEET :

E5.1